



RESOURCE
INNOVATION
INSTITUTE



Efficient
Yields

Best practices on energy,
water efficiency, and productivity

Greenhouse Optimization - Aligning Your Systems with Your Surroundings

In partnership with



TRI-COUNTY REGIONAL ENERGY NETWORK

SAN LUIS OBISPO • SANTA BARBARA • VENTURA

December 2, 2021

Agenda

About RII	1:30 pm PT
Introductions & Purpose	1:35 pm
Controls & Automation in Greenhouses	1:45 pm
Building Envelope & Shading Devices	2:00 pm
Greenhouse Lighting Controls & Automation	2:20 pm
Environmental Controls Avoiding Microclimates	2:40 pm
Efficiency Program Examples	3:00 pm
Q&A	3:15 pm





SECTION 01

WELCOME & ABOUT RII

ABOUT US

About RII

Objective, data-driven non-profit

Founded 2016 in Portland, Oregon

Expertise in climate policy, utility programs,
green building certification, sustainable
business, construction & indoor cultivation

In 2020, received 3-year grant from USDA to
develop KPIs, standards & building rating
system for CEA



What We Do / Our Mission

We measure, verify & celebrate the world's most efficient agricultural ideas.



Measure

Efficiency & Productivity

- Key Performance Indicators
- Benchmarks
- Baselines



Verify

Best Practices & Standards

- Training
- Policies
- Utility Programs



Celebrate

Leadership Recognition

- Verification
- Case Studies
- Certification

ABOUT RII

Our Network



ABOUT RII

Technical Advisory Council

Multi-disciplinary body who aggregates knowledge to support producers and other stakeholders with objective and peer-reviewed data and curriculum on benchmarking resource efficiency

- Guides development of standards
- Shapes tools and resources to support best practices
- Advocates for informed policies, incentives and regulations

HVAC - Lighting - Utility - Water
Policy - Data - Controls - Emissions
Facility Design & Construction




PowerScore Benchmarking

Specialized Key Performance Indicators

- Performance Snapshots
 - Year-over-year energy, water, and emissions rankings
 - Third-party data verification
- PowerScore Comply in select jurisdictions
- Access PowerScore Pro as an RII member
 - Enhanced portfolio management
 - Dashboard reports
 - Filters
 - Access Ranked Data Set

Competitive business insights

- Get ahead of compliance
- Assess portfolios of facilities to continuously improve
- Prioritize capital projects
- Forecast KPIs for new facilities and retrofits

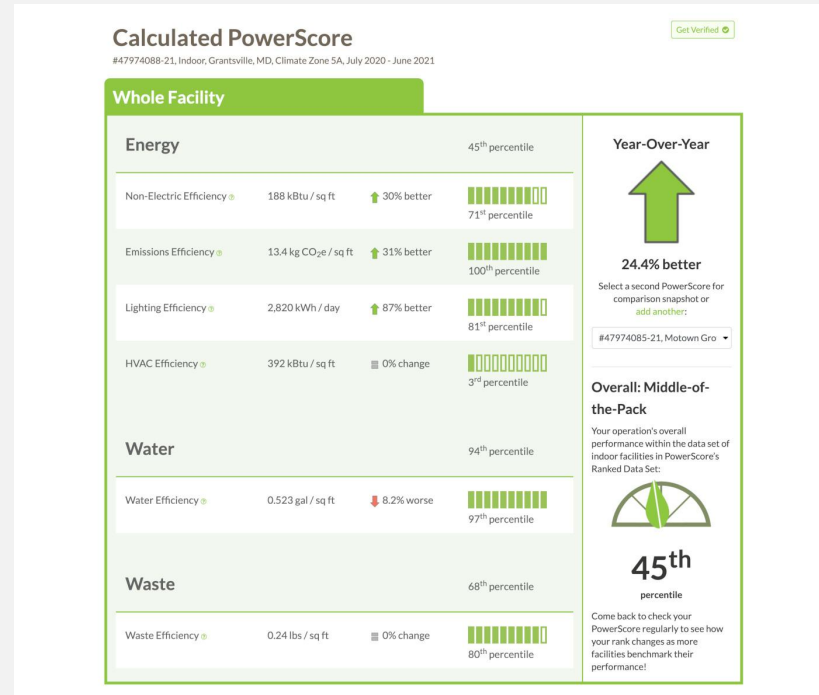

ABOUT RII

Informing Audiences with Peer-Reviewed Publications




Best Practices Guides
for Producers



Primers
for Governments & Utilities



Collaborative Reports
on Resource Usage

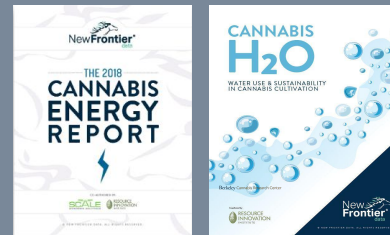

Intelligence Insights
for Members



A large indoor cannabis cultivation facility. The image shows rows of cannabis plants in a greenhouse-like structure. The plants are growing in a multi-tiered system. The facility is equipped with numerous fans and lights, indicating a controlled environment. The overall scene is dimly lit, with a blueish tint, suggesting a controlled atmosphere.

SECTION 02

INTRODUCTIONS & PURPOSE

Today's Speakers



Gretchen Schimelpfenig



Kyle Edmiston



Josh Holleb



Marc Paynter



Karl Johnson




3C-REN: Tri-County Regional Energy Network



TRI-COUNTY REGIONAL ENERGY NETWORK
SAN LUIS OBISPO • SANTA BARBARA • VENTURA

Three counties working together to improve energy efficiency in the region with free programs:

- Energy Code Connect
 - Building professionals
 - Makes the Energy Code easy to follow
- Building Performance Training
 - Current and prospective building professionals
 - Helps workers thrive in an evolving industry
- Home Energy Savings
 - Homeowners and renters
 - Improves home comfort and safety
- [Upcoming Courses](#)

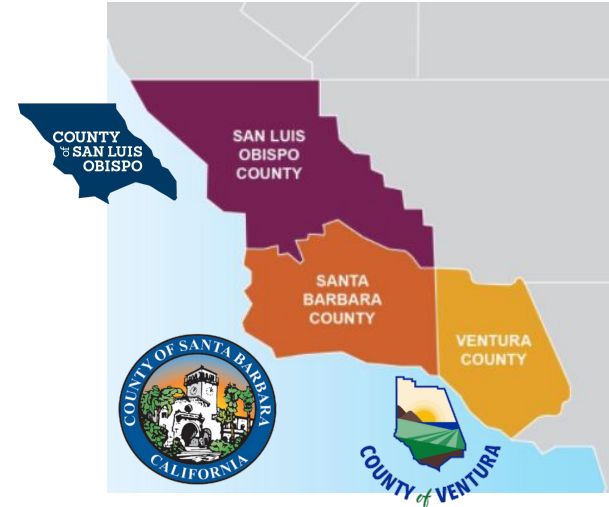

Purpose of Today's Workshop




TRI-COUNTY REGIONAL ENERGY NETWORK
SAN LUIS OBISPO • SANTA BARBARA • VENTURA

Help cannabis producers improve the efficiency of their operations with environmental control systems

Convey scientific insights directly to producers and finding the best ways to translate them in the context of a local ecosystem

Help government agencies and energy efficiency programs achieve their climate goals through knowledge sharing

Encourage cultivators to take advantage of 3C-REN resources to support compliance with County energy conservation plans

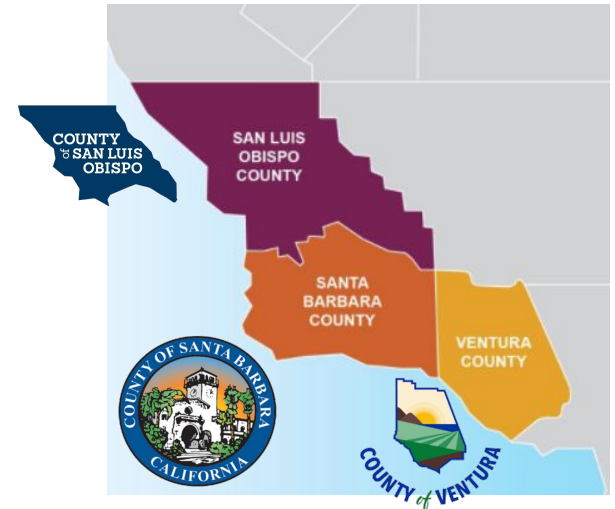

Access Your Tri-County Virtual Classroom


Access the virtual classroom to continue learning

Free guidance on efficient cannabis cultivation

All live workshops are available for on-demand viewing!

- Recordings of live workshops
- Tip Clips
- Downloadable resources
- 3C-REN tools

Create an account at
ResourceInnovation.org/Tri-County

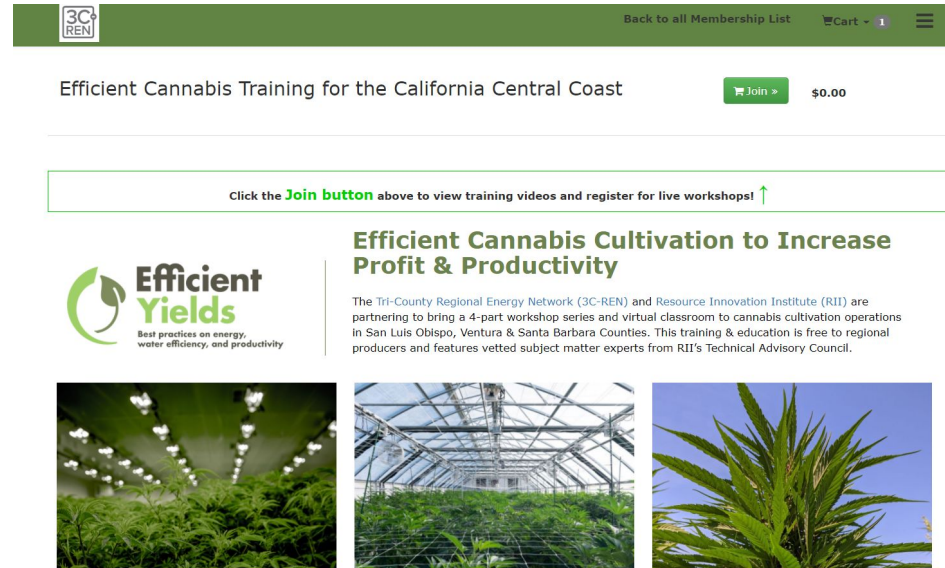

The screenshot shows a website interface with a green header. On the left is the 3C-REN logo. On the right, there are links for 'Back to all Membership List', a shopping cart icon with '1' item, and a menu icon. Below the header, the main content area features a workshop listing: 'Efficient Cannabis Training for the California Central Coast' with a 'Join >' button and a price of '\$0.00'. A call-to-action box below the listing says 'Click the **Join button** above to view training videos and register for live workshops! ↑'. To the left of the main text is the 'Efficient Yields' logo with the tagline 'Best practices on energy, water efficiency, and productivity'. To the right is the title 'Efficient Cannabis Cultivation to Increase Profit & Productivity' followed by a paragraph: 'The Tri-County Regional Energy Network (3C-REN) and Resource Innovation Institute (RII) are partnering to bring a 4-part workshop series and virtual classroom to cannabis cultivation operations in San Luis Obispo, Ventura & Santa Barbara Counties. This training & education is free to regional producers and features vetted subject matter experts from RII's Technical Advisory Council.' At the bottom, there are three images: a cannabis grow room with lights, a large greenhouse structure, and a close-up of a cannabis plant against a blue sky.


Register for the Workshop Series

Access the virtual classroom to continue learning

Free guidance on efficient cannabis cultivation

All live workshops are available for on-demand viewing!

- Feb 3, 2022
 - Indoor Optimization - HVAC & Lighting Best Practices
- Apr 7, 2022
 - Sungrown Efficiency - Optimizing the Energy-Water Nexus




Product Type
WEBINAR

Efficient Yields Tri-County: Indoor Optimization - HVAC & Lighting Best Practices

Faculty: Gretchen Schimelpfenig
Duration: 2 hours
Price: \$0.00 - 3C-REN

🕒 Thu, Feb 03, 2022 - 01:30pm to 03:30pm PST

[More info »](#)
[Save for Later](#)
[Register](#)



Product Type
WEBINAR

Efficient Yields Tri-County: Sungrown Efficiency - Optimizing the Energy-Water Nexus

Faculty: Gretchen Schimelpfenig
Duration: 2 hours
Price: \$0.00 - 3C-REN

🕒 Thu, Apr 07, 2022 - 01:30pm to 03:30pm PDT

[More info »](#)
[Save for Later](#)
[Register](#)



REGISTER!



**Efficient
Yields**
Best practices on energy,
water efficiency, and productivity

INDOOR OPTIMIZATION

**HVAC AND LIGHTING
BEST PRACTICES**



**RESOURCE
INNOVATION
INSTITUTE**

Feb. 3, 2022





REGISTER!

Efficient
Yields

Best practices on energy,
water efficiency, and productivity

SUNGROWN EFFICIENCY

OPTIMIZING
ENERGY-WATER NEXUS



RESOURCE
INNOVATION
INSTITUTE



Apr. 7, 2022



SECTION 02

**CONTROLS & AUTOMATION
IN GREENHOUSES**

Managing Energy with Controls

Sources of Energy Use

Cultivation operations may use:

Electricity

- Electricity for horticultural lighting
- Electricity for HVAC processes
- Electricity for motors:
 - Pumping water
 - Actuating greenhouse vents
 - Running fans

Fuel (natural gas, propane)

- Fuel for heating processes
- Fuel for combined heat and power (CHP)




Download the Controls Best Practices Guide

Brand-agnostic information for producers

Free guidance on lighting, HVAC, and water controls

- Speak the language relevant to controlling and automating environmental control systems in horticultural applications
- Understand types of control systems optimizing horticultural environments
- Plan for integrated controls approaches in greenhouses and indoor operations
- Install and operating successful controls solutions in alignment with business models
- Use data from control systems to improve productivity and efficiency
- Demonstrate energy savings for utility energy efficiency incentive programs

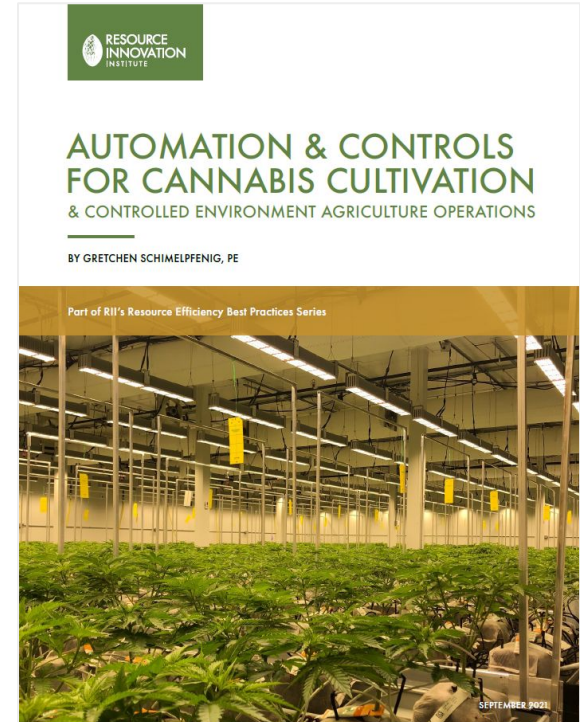

DOWNLOAD NOW

Start Your Journey to Automation

Design Conditions vs. Target Conditions

- Optimize for producing for the entire year
 - Consistent yields
 - Verifiable results


Controls Considerations

- Wired vs wireless control systems
- Sensor placement
- Point of control
- Resolution & accuracy
- Integration
- Maintenance & end of life planning



Fully Integrated Controls

- **Feedback**
 - Reacting to a change
- **Feed forward (integrated)**
 - Acting preemptively and predictively
- **Integration benefits**
 - Reduce wear and tear
 - Improve control
 - Save energy
 - Save water
 - Real time data for troubleshooting

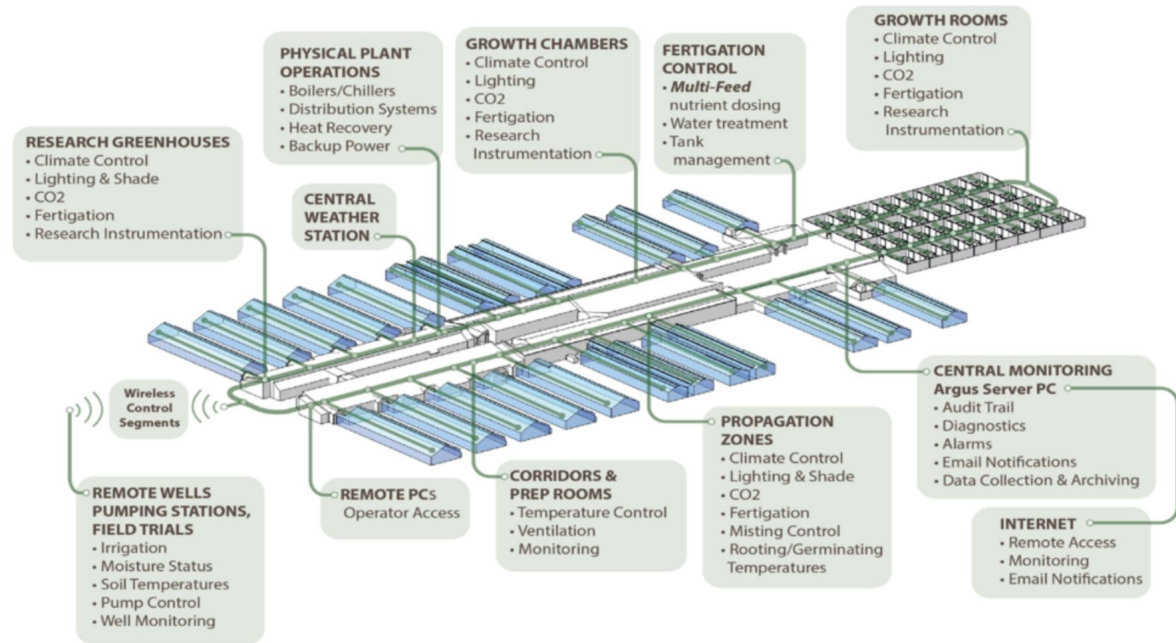

Benefits of Commissioning

Ensure Mission-Critical Systems Perform Optimally

- Improve maintenance procedures
- Save staff time
- Reduce operations & maintenance expenses
- Save energy: 3% and 12% for industrial facilities
- Verify systems respond as expected
- Validate resource efficiency
- Resolve problems before product at risk
- Avoid expensive fixes requiring shutdowns in operation

CANNABIS
BUSINESS TIMES

**Reduce Expenses by
Commissioning Your Cannabis
Facility**

READ MORE

Design-Phase Commissioning

Third-Party Review of Project Design Docs

- Review Owner's Project Requirements (OPR) including target setpoints, standard operating procedures, failure conditions
- Assist design team with creating Basis of Design (BOD)
- Develop a commissioning plan
- Perform design review of drawings
- Review equipment submittals
- Identify issues & suggest adjustments



Design-Phase Commissioning

Early Engagement to Plan Controls

- Design for annual production
 - All seasons and consistent production
- Analyze supplemental lighting needs
- Understand interactive effects on systems:
 - Power
 - HVAC and humidity management
 - Water
- Plan your controls system responses to conditions outside of target ranges

	Average Daily DLI	Delivered Avg DLI	Required DLI
Month	Hagerstown, MD		
January	14.6	10.22	36.78
February	20.6	14.42	32.58
March	28.7	20.09	26.91
April	35.4	24.78	22.22
May	41.4	28.98	18.02
June	44.1	30.87	16.13
July	43.5	30.45	16.55
August	39.1	27.37	19.63
September	31.2	21.84	25.16
October	23.2	16.24	30.76
November	16.1	11.27	35.73
December	13.2	9.24	37.76

Construction-Phase Commissioning

Performance Testing to Validate Controls

- Multistage process involving several project team members:
 - Construction manager
 - Controls contractor
 - Commissioning agent
- Create prefunctional checklists and functional performance tests and work with controls contractors to witness and record all functional tests
- Identify issues in the field and issue reports recommending resolutions
- Create staff training agendas
- Produce a final commissioning report
- Ensure that Contractors have provided operations and maintenance (O&M) manuals



STEP 2:
 Begin
 Construction



STEP 3:
 Startup
 Timeframe: days



STEP 4:
 Configuration
 Timeframe: weeks



STEP 5:
 Construction Phase
 Commissioning
 Timeframe: months



SECTION 05


BUILDING ENVELOPE & SHADING DEVICES

Greenhouse Climate Control Approaches

Passive Climate Control

Ventilated greenhouses can use low-energy solutions like roof vents to release hot, humid air.

Passive solutions can manage climatic conditions in greenhouses, but actual environmental conditions can range widely.

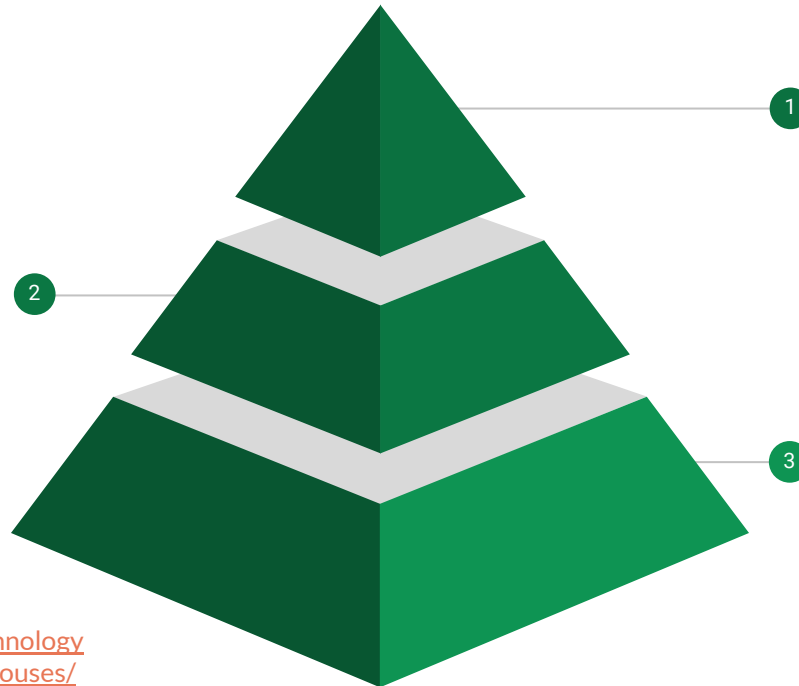

Active Climate Control

Ventilated greenhouses can be actively ventilated using ventilation fans to cool and dehumidify growing spaces.

Well-sealed greenhouses can achieve target environmental conditions by using fans, evaporative cooling walls, refrigerant-based cooling and dehumidification equipment, and mechanical heating systems.

Greenhouse Envelope

Ventilated greenhouses use plastic or glass coverings which are hard to completely seal.

Greenhouses with insulated and tightly sealed envelopes can more actively control climate and achieve target environmental conditions.

Different Greenhouse Techniques

Ventilated Greenhouses

- Can utilize building envelope for HVAC & dehumidification
- Can use ventilation to control temperature and humidity
- Might use mechanical climate control equipment

Sealed Greenhouses

- Hybrid building envelope of opaque and transparent walls
- Well-insulated and tightly sealed envelope
- Must use mechanical climate control equipment



Upcoming Greenhouse Code Changes



Read the [Final
CASE Report](#)

Greenhouse Envelope Standards

- *Opaque* walls and *opaque* roof assemblies must meet the existing mandatory insulation requirements in Section 120.7.
- *Non-opaque* wall assemblies must have a combined **U-factor of 0.7** or less
- *Non-opaque* roof assemblies must have a combined **U-factor of 0.7** or less
- Exempts greenhouses from existing prescriptive building envelope requirements for window wall ratio, skylight roof ratio, and daylighting requirements for large enclosed spaces
- Applies to:
 - Newly constructed greenhouses and to greenhouses being converted from unconditioned to conditioned
 - Additions to conditioned greenhouses

Greenhouse Envelope Performance



Read the [Final
CASE Report](#)

Insulation

- Greenhouse buildings are constructed in many different ways, and to describe them, it is useful to understand some building system terms.
- Thermal envelopes are sometimes referred to as a building's skin, or shell; you can think of them like your greenhouse's coat in the winter and sunscreen in the summer. Weatherization describes activities you can do to improve thermal envelopes.
- Weatherization activities include insulating , which minimize unwanted heat losses and gains, and air sealing, which reduces the infiltration of outside air.
- Insulation is rated using R-value (a higher value is better) or the U-value (the inverse of R-value, where a lower value is better).

Greenhouse Envelope Performance

Read the [Final
CASE Report](#)

Greenhouse Coverings

- Popular covering types include rigid plastic, film plastic, and glass
- Each can vary in cost, durability, light transmission, and insulation
- Insulative qualities depend on the type and the thickness
- Rigid plastic products like polycarbonate, acrylic, and fiberglass are popular as they can feature multiple layers of walls which trap air for lower U-value
 - Single wall polycarbonate will not comply
- Film plastic is attractive due to its low cost, but provides no insulation
 - Will not comply without double layers of film and an air gap
- Glass has varying insulation ratings
 - Single pane will not comply

Greenhouse Envelope Performance

Read the [Final CASE Report](#)

Insulative Qualities of Coverings


Covering Type	U-Factor	Cost / Square Foot (\$USD/sf)	Useful Life (Years)
Polycarbonate, Five Wall, 25 mm	0.31	\$8.00	10 -15
Polycarbonate, Triple Wall, 8 mm	0.50	\$4.00	10 -15
Double-Pane Storm Windows	0.50	\$6.00	25+
Polyethylene film, Double, with IR	0.50	\$0.25	3 - 4
Polycarbonate, Double Wall, 10 mm	0.53	\$2.50	15
Acrylic, Double	0.56	\$2.66	30+
Polycarbonate, Double Wall, 6 mm	0.65	\$1.54	10 -15
Polycarbonate, Double Wall, 4 mm	0.70	\$1.50	10 -15
Glass, Double Pane	0.70	\$6.00	25+
Polyethylene film, Double	0.70	\$0.18	3 -4



Sealed Greenhouses

Finely Tuned Environmental Conditions

- Sealed greenhouses are more capable of achieving target environmental conditions because they are **less sensitive to ambient conditions** due to less outdoor air infiltration and have **better thermal performance** than ventilated greenhouses.
- Cultivars in traditional greenhouses experience wide temperature variation across cultivation spaces:
 - +/- 10 degrees F variance from target temperatures and +/- 10% from the target RH
 - +/- 7 degrees F temperature differences between the intake and fan (exhaust) ends of the same greenhouse bay

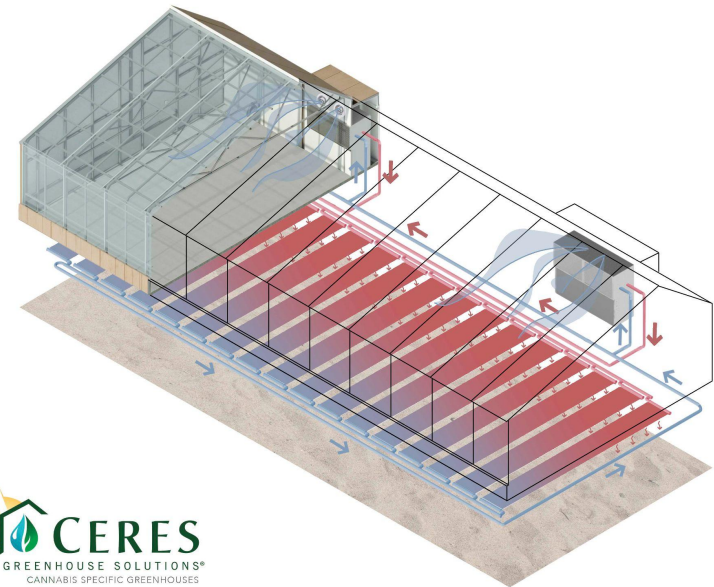



RESOURCE
INNOVATION
INSTITUTE

TIP CLIP:

Building Envelope:
Sealing & Insulating

With Josh Holleb
Ceres Greenhouse
Solutions



WATCH

External & Internal Equipment

External Building Envelope: Vents

- Materials selection has huge impact on building performance
 - Finding the best ratio of insulation to glazing
- Natural ventilation to allow heat to escape and fresh air inside

Internal Building Envelope: Thermal Curtains

- Insulation and management of solar conditions

Fans

- Active ventilation & circulation to optimize airflow

Cooling & Heating

- Active processes to reduce or increase temperature




External Building Envelope: Vents

Ridge Vents

- Hot air inside the greenhouse escapes through roof opening
- Manually operated or automatically controlled

Side Wall Curtains

- Rigid plastic rolled up via crank, or opens from the top and drops down
- Manually operated

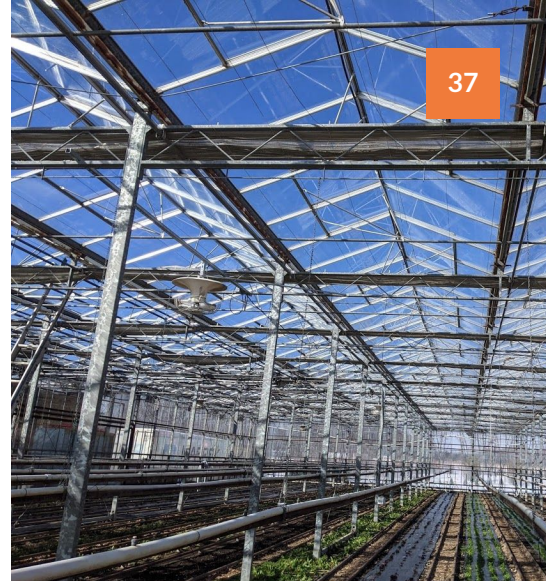

External Building Envelope: Vents

Side Wall Vents

- Rigid vents operated via rack and pinion systems
- Covered with rigid or film plastic for longer life
- 2 - 3X more expensive than side wall curtains
- Provide a much tighter seal to hold in heat
- Manually operated or automated



Shade and Thermal Curtains

Climate Curtains

- Some curtains both shade and insulate, some do one or the other
 - Open-weave curtains may not insulate
 - Transparent thermal curtains may not shade
- Screens can:
 - Manage solar radiation
 - Reduce heat loss at night and in colder months
 - Protect plants on sunny and hot days
 - Save energy on both heating and cooling
 - Reduce utility bills
- Manually operated or automatically controlled



Right Climate for Growth

The Right Climate for Growth

A better climate for every crop



Light



Temperature



Energy

Optimizing these factors is key to achieving growing goals.

Climate screens allow you to effortlessly control your crops climate, from managing light to temperature, you can enjoy the benefits of complete climate control:



Lower energy costs



Less risk of disease



Higher-quality crop



Higher yields



Faster Production



Optimal temperature



RESOURCE
INNOVATION
INSTITUTE

TIP CLIP:

Shading Devices

With Kyle Edmiston
Svensson

WATCH

Different Screens for Different Goals



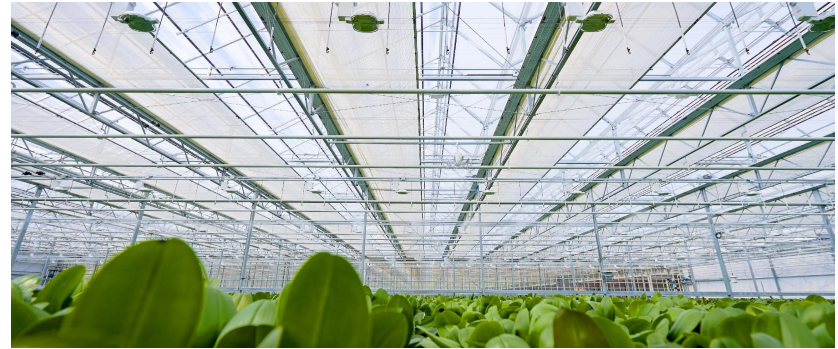




Figure credit: Ludvig Svensson

Diffusion: Even Temperature & Lighting

open

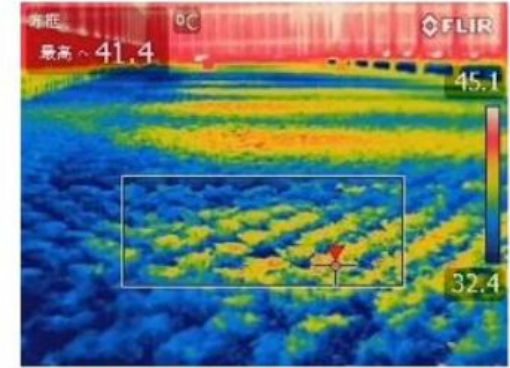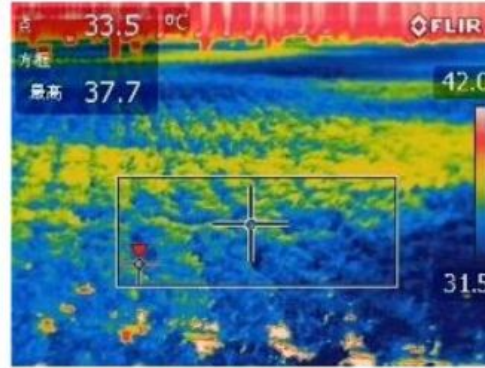

closed

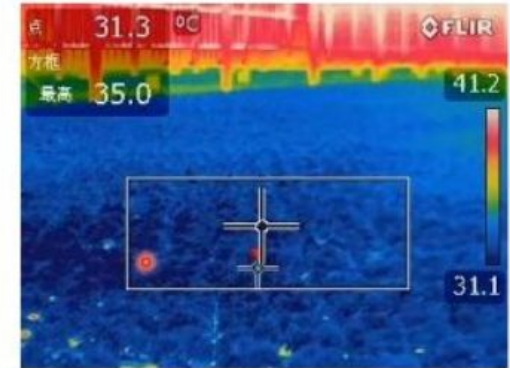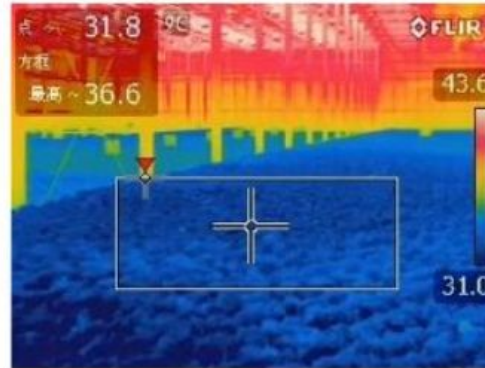

Other Light Deprivation Considerations




Light Traps



Figure credit: Ludvig Svensson **Rollup Screens & Side Walls**

Moisture Management in Screens

- Reduces risk of diseases
 - Powdery mildew
 - Gray mold
 - Other fungal diseases
- Helps prevent humidity level extremes and condensation formation on the screen
- Humidity control is vital during flowering

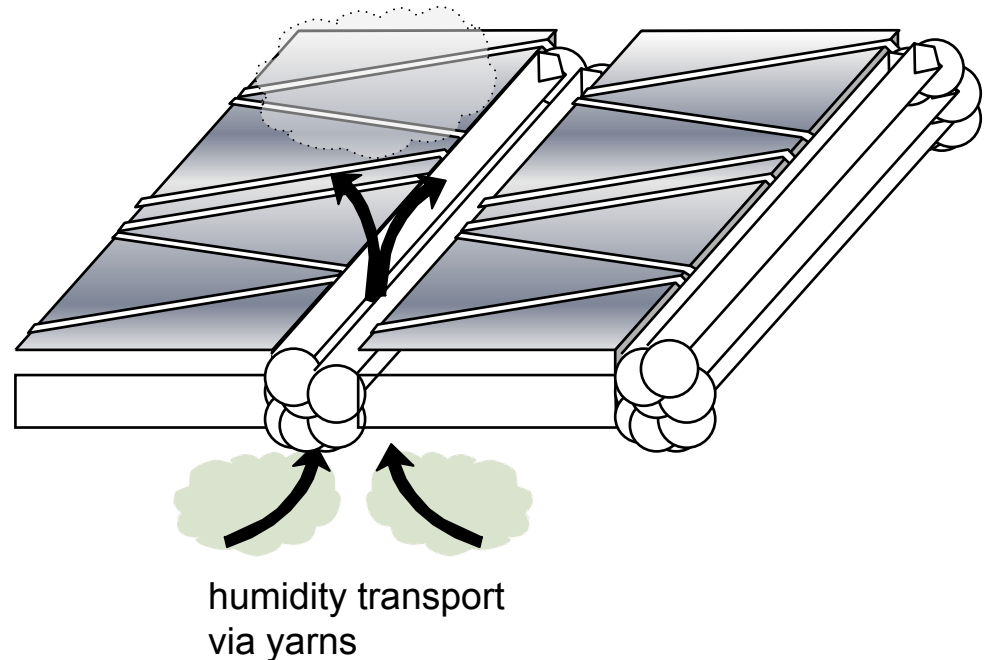

Southern California Energy Savings from Curtains

ANNUAL SUMMARY			
Scenario names	No screen	Blackout only	Blackout & Energy Screen
Screen 1	-	BSCURA_10070_FR_WB+BV	BSCURA_10070_FR_WB+BV
Screen 2	-	-	HARMONY_2047_FR
Screen 3	-	-	-
Vertical 1	-	OBSCURA_10070_R_FR_W	OBSCURA_10070_R_FR_W
Vertical 2	-	-	-
Energy consumpt. (m3 gas)	575 480	489 455	339 601
m3 gas/m ²	58.13	49.44	34.30
Energy expenditure	374 062	318 145	220 741
US Dollars/m ²	37.8	32.1	22.3
Energy saving (%)	-	15%	41%
Investment	-	148 500	188 100
US Dollars/m ²	-	15.00	19.00
Return on investment (year)	-	2.7	1.2

Diffusion: Even Temperature & Lighting


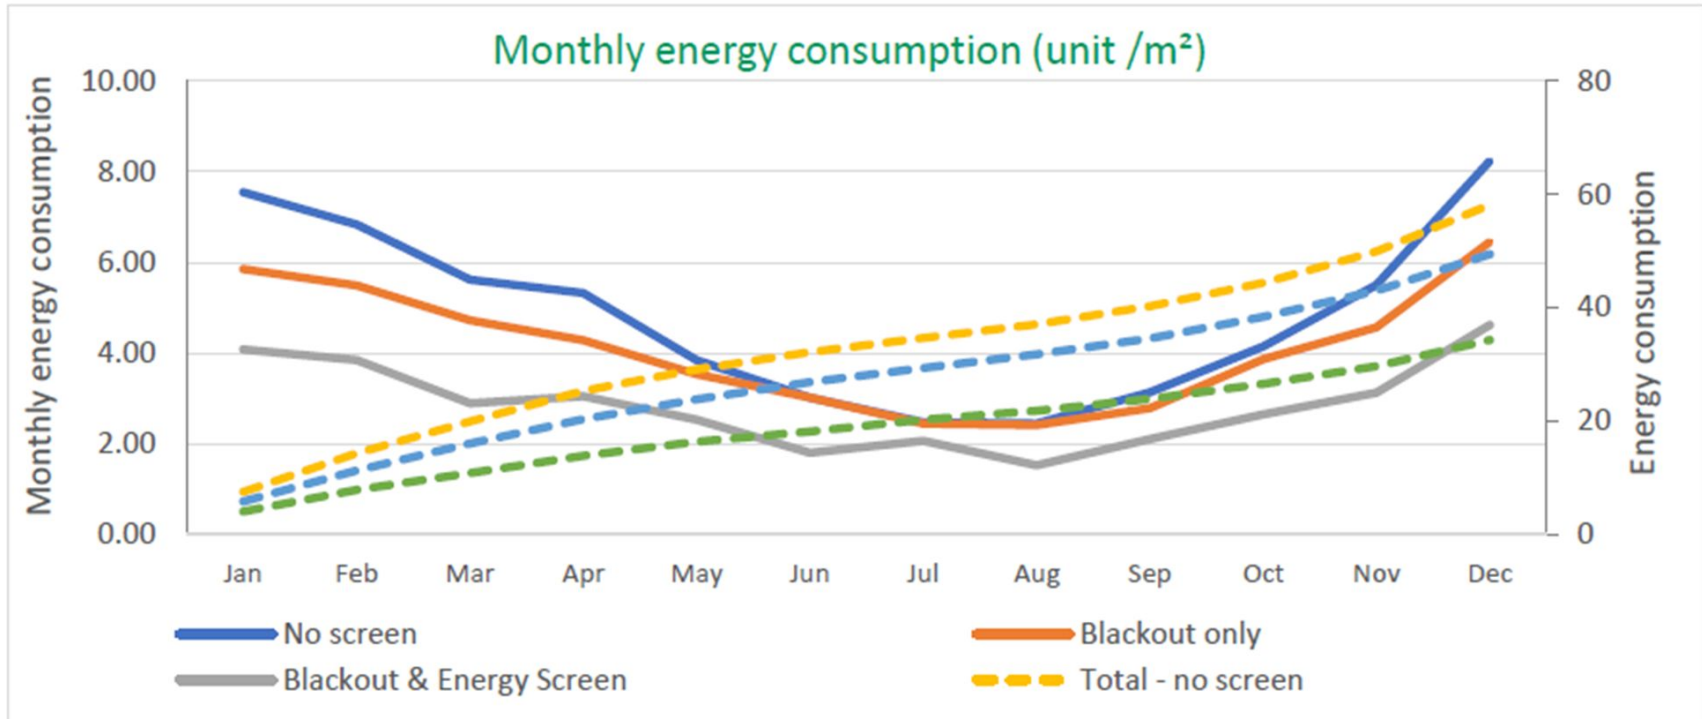


Figure credit: Ludvig Svensson


Shade Curtains to Maintain DLI Targets

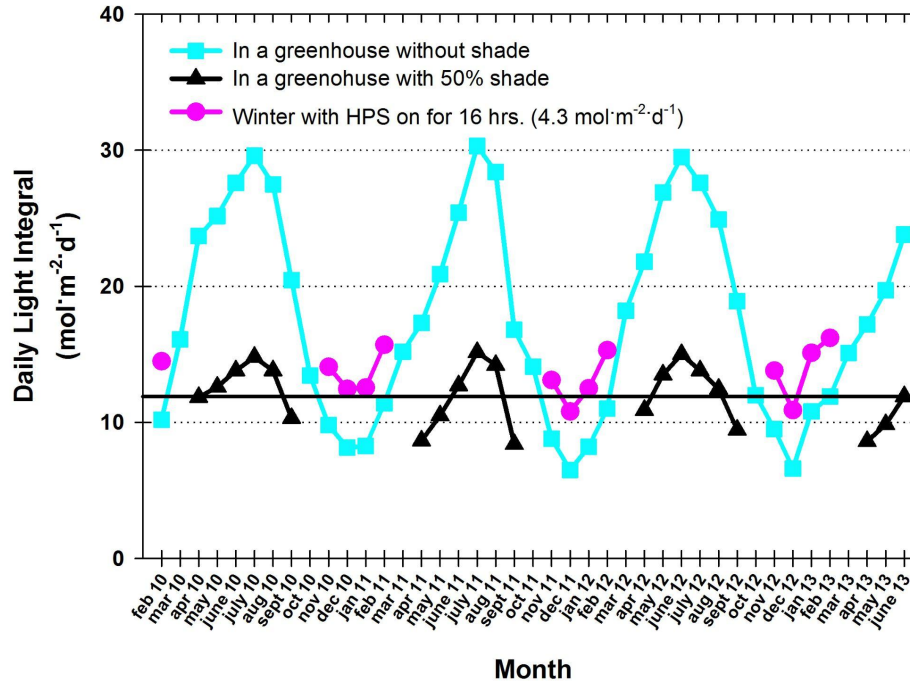


R.G. Lopez, 2013

Blackout Screens: Energy Loss


- Heat, humidity can build up under normal blackout screens increased by:
 - Supplemental lights
 - Pipe temperature
 - Climate
- Common Solution: Gapping Screens
- Common Issues:
 - Difficult to manage
 - Light abatement regulations becoming common
- Solution: Active dehumidification with vertical air movement

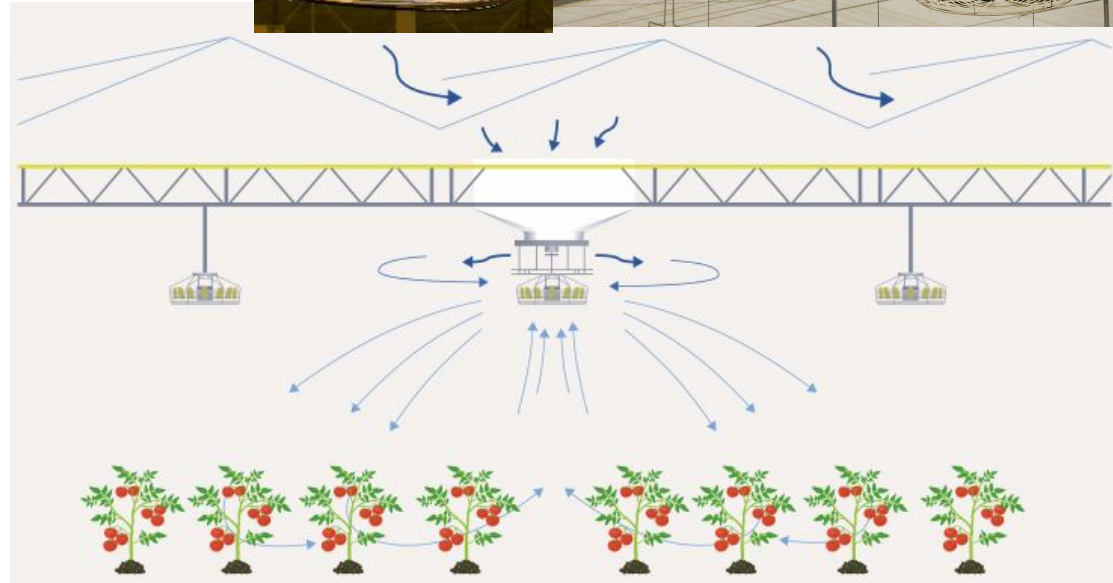

Vertical Air Movement Energy Savings Potential

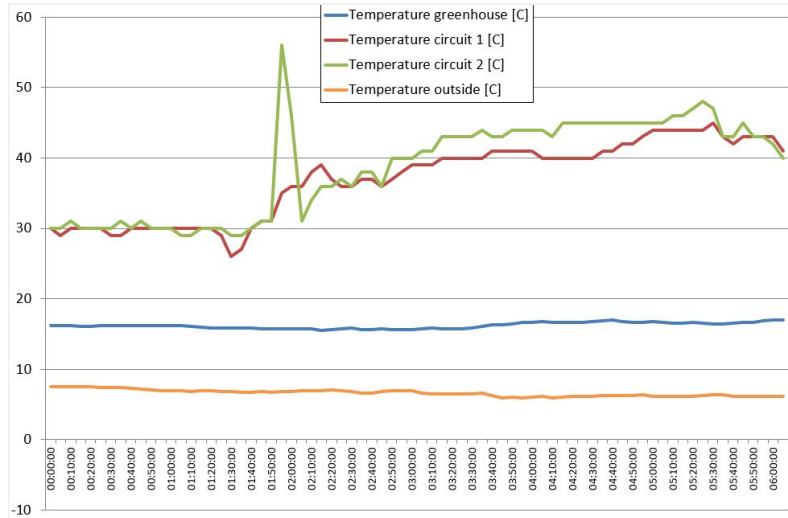

Screen in open position

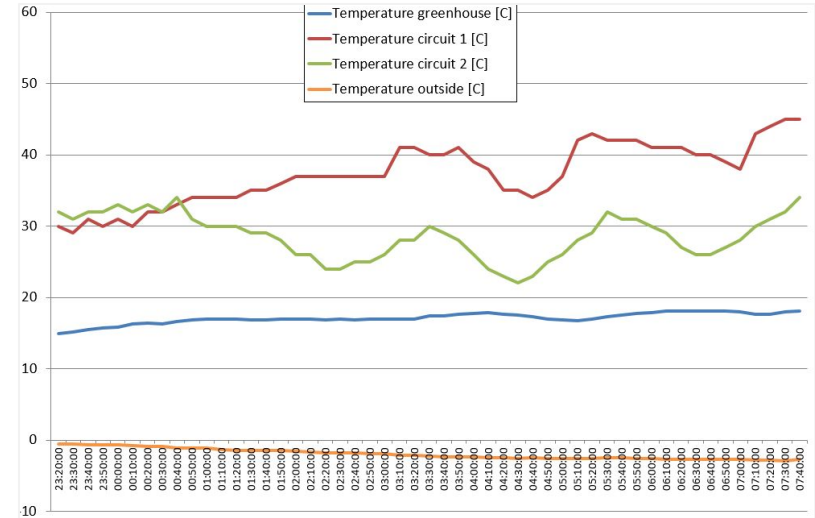

Screen in closed position

Increase Fabric Longevity with Programming



Envelope/Shade/Thermal Curtain In Warm Climate Field Example

New Mexico Project

- 5725 ft elevation
- Opaque insulated E/W/N walls and N roof
- Shade curtain with 36% shade and 47% heat retention
- “It was 20 degrees last night and with no heat at all it didn’t drop below 65 degrees in the greenhouse overnight”



Dive Deeper into Greenhouse Controls

The Carbon Emission
Impacts of Greenhouse
Cannabis Cultivation

CANNABIS
BUSINESS TIMES

[READ MORE](#)

Optimizing Systems for
Cannabis Greenhouses

**GREENHOUSE
GROWER** 

[READ MORE](#)

Articles co-authored by RII with members of our Technical Advisory Council Working Groups

A photograph of a modern greenhouse interior. The scene is filled with rows of green plants growing in a structured environment. Overhead, there are long, narrow lighting fixtures mounted on a metal framework. The lighting is dim, creating a soft, ambient glow. The background shows the structural elements of the greenhouse, including metal beams and a translucent covering. The overall atmosphere is one of a controlled, high-tech agricultural setting.

SECTION 06

LIGHTING CONTROLS & AUTOMATION


Lighting Controls: Value Proposition

Dial in the number one nutrient for plants

Provide with granularity:

- Proper light levels
- Optimal spectra for cultivars
- Preferred photoperiod by stage of development
- Desired DLI to empower plant growth

Provide plants with the exact intensity and quantity of light while minimizing energy consumption and lowering bills

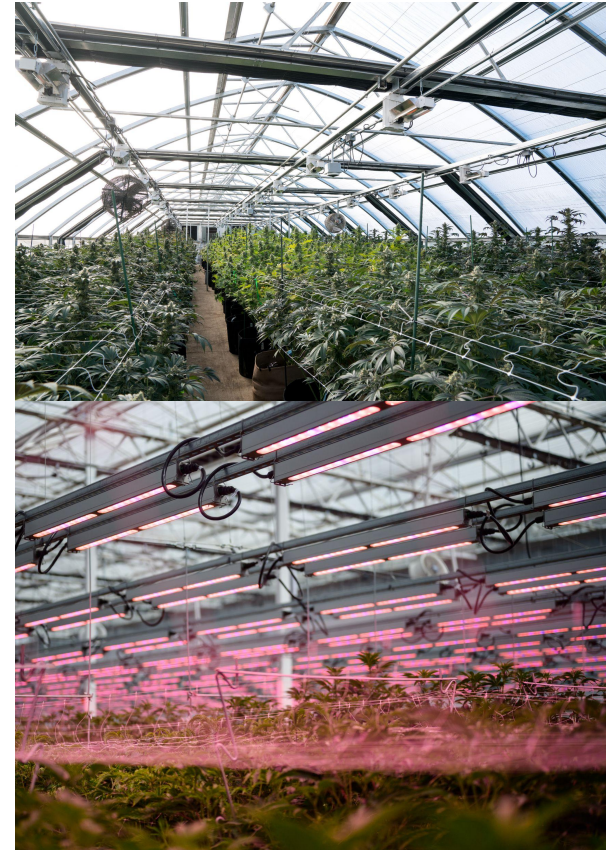



RESOURCE
INNOVATION
INSTITUTE

TIP CLIP:

Greenhouse Lighting
Controls & Automation
Best Practices: LED

With Colin Brice
Signify



WATCH

Read the [Final
CASE Report](#)

Lighting Efficacy and Controls

Greenhouse Growing, Horticultural Lighting

In a building with CEH spaces and with more than 40 kW of aggregate horticultural lighting load, the electric lighting systems used for plant growth and plant maintenance shall meet the following requirements:

1. Luminaires shall have a photosynthetic photon efficacy of at least **1.7 micromoles per joule** rated in accordance with ANSI / ASABE S640 for wavelengths from 400 to 700 nanometers.
2. Time-switch lighting controls shall be installed and comply with [Section 110.9\(b\)1](#), [Section 130.4\(a\)4](#), and applicable sections of [NA7.6.2](#).
3. Multilevel lighting controls shall be installed and comply with [Section 130.1\(b\)](#).



Designing Lighting Controls Systems

Planning Lighting Controls

- Facility location
- Crop being grown
- Growing seasons
- Cost vs. performance
- Perpetual harvest
- Maximizing production
- Balancing efficiency

Provide plants with the exact intensity and quantity of light while minimizing energy consumption and lowering bills




Specify Control Parameters

Target Ranges for Best Outcomes for Plants

- PPFD
- DLI

Determine the information sensors will use to modulate equipment output to meet thresholds

PPFD vs. DLI

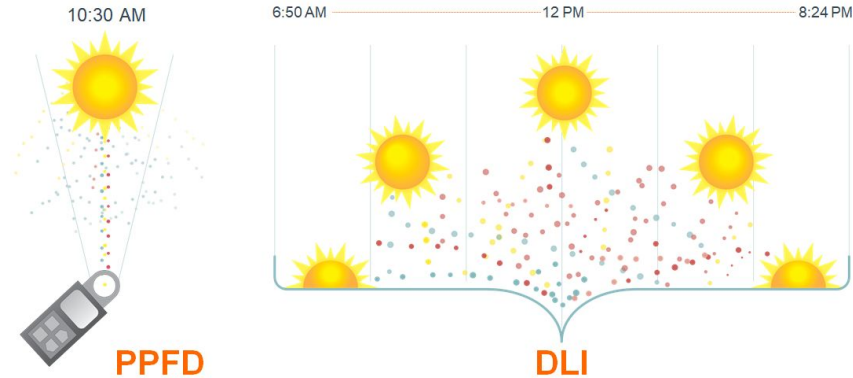

The screenshot shows a mobile application interface for greenhouse management. On the left is a sidebar with a location selector set to 'Gibby's Garden' and a list of greenhouses: 'Greenhouse 1', 'Branston St. GH', and 'Mystique'. The main area is titled 'OVERVIEW' and displays details for two greenhouses:

Greenhouse Name	Address	ID	Action
Greenhouse 1	113 Main St. August ME	2039562945	Manage
Branston St. GH	1920 Branston St. August ME	2039562945	Manage

Designing Lighting Controls

Power and Light Planning


- Pre-install design, mapping, PPFD
- Configuration vs commissioning
- Post-install verification

Fixture Layout

Flower House	9			Junction Boxes/Module	Junction Box/Module Code	TG-1000HVR Fixtures/module	TG-1000HVR Power/Fixtures (W)	Power/Module (W)
Itemized	Cabinet	TGHV #	Module #					
	RA01	1	1	1	RA01,1-1	3	1000	3000
			2	1	RA01,1-2	3	1000	3000
			3	1	RA01,1-3	3	1000	3000
			4	1	RA01,1-4	3	1000	3000
			5	1	RA01,1-5	3	1000	3000
			6	1	RA01,1-6	3	1000	3000
						3	1000	3000
						3	1000	3000
						3	1000	3000
						3	1000	3000
						3	1000	3000
						3	1000	3000
						3	1000	3000
						3	1000	3000
						3	1000	3000
						3	1000	3000

The screenshot shows a software interface with a 'Pre-Defined Command List' on the left and a table of operations in the center.

Seq. No.	Unit Addr	Device Addr	Operation	Length	Command Code	Actual Data
0	0	16: MODULE1	Read	0	D3H: MODULE_CONFIG	-
1	0	17: MODULE2	Read	0	D3H: MODULE_CONFIG	-
2	0	18: MODULE3	Read	0	D3H: MODULE_CONFIG	-
3	0	19: MODULE4	Read	0	D3H: MODULE_CONFIG	-
4	0	20: MODULE5	Read	0	D3H: MODULE_CONFIG	-
5	0	21: MODULE6	Read	0	D3H: MODULE_CONFIG	-
6	0	22: MODULE7	Read	0	D3H: MODULE_CONFIG	-
7	0	23: MODULE8	Read	0	D3H: MODULE_CONFIG	-

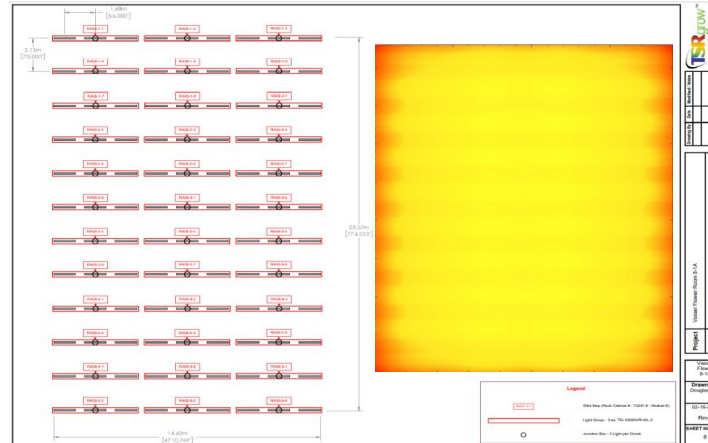

Lighting Controls: Recipes for Cannabis Steering

Gather data to support lighting controls incentives

Table 4: Lighting Controls for Cannabis Steering by Stage of Plant Growth⁶

Lighting Controls	Vegetative	Flowering	Ranges of Controls Values
PPFD	Lower	Higher	300 - 1500+ $\mu\text{mol}/\text{m}^2/\text{s}$
DLI	Less	More	20 - 42 $\text{moles}/\text{m}^2/\text{day}$
Spectral Treatments (R:B ratio)	Higher	Lower	7 - 15%; higher blue for shorter plants
Far Red Treatments	More	Less	Used to manage shade avoidance

Systems to Control: Lighting

Sensors and their integration

- New construction or existing
- Wireless vs. wired
- Determine zones
- Controlling vs monitoring
- Key points to monitor



Lighting Controls Strategies

Scheduling

- Adjust photoperiod

Dimming

- Modulate light intensity by zone of control
 - Daily
 - By stage of plant growth

Spectral Tuning

- Modulate photon output from wavelength ranges

Understand energy savings potential of strategies and data needed to validate performance

Table 3: Lighting Controls Parameters Measured by Cannabis Cultivators

Lighting Data Collected ⁵	Percentage of Growers Collecting, 2020
Light intensity (PPFD)	55%
Spectral quality	33%





Dimming Controls to Meet DLI Targets

Daylighting Controls for Greenhouses

- Dimming
 - Thresholds
 - Response rates


Maintain light levels to the canopy

Avoid under-lighting or over-lighting

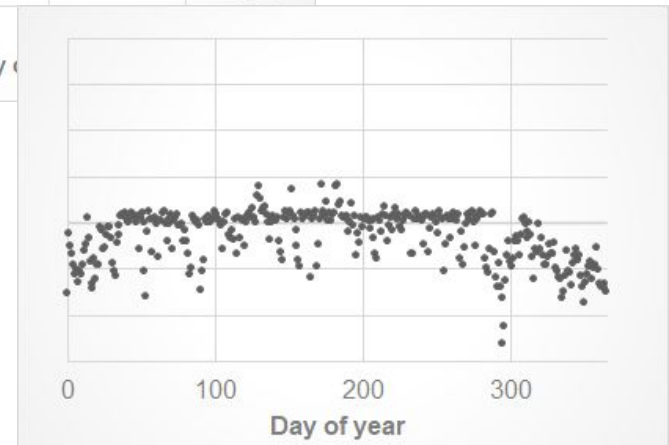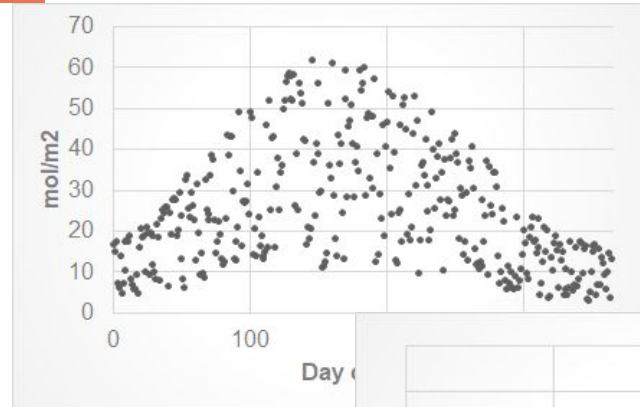

Energy Savings from DLI Controls

Academic greenhouse observed 30% energy savings from using controllers to operate lights off sunlight intensity compared to operating off timers

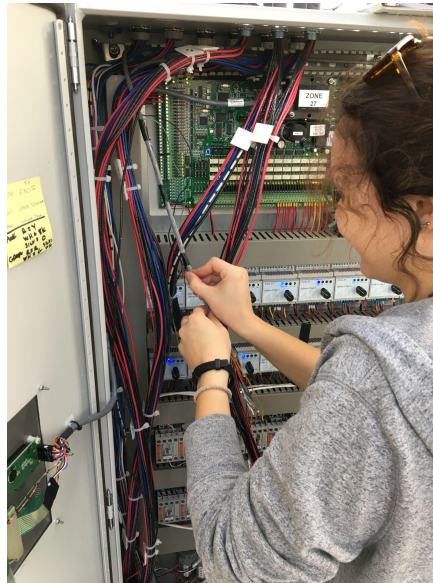

Feed-Forward Controls for Lighting

Lighting Benefits from Predictive Controls

- Predictive controls and cost-effectiveness
 - Weather
 - Peak demand
 - Shade control integration
 - Photoperiods
 - DLI

Map Your Controls and Responses

- Zones
- Dimming
- Response rates
- Ambient conditions and interactive effects



Commissioning Lighting Controls


Advanced Lighting Systems

- Verification of installation
- Remote monitoring
- Integrated startup and commissioning
- Reporting and metrics and verification

Target Setpoints



- Zones
- Ranges
- Choosing control values
- Set points that are sustainable year round

Power Savings TSRgrow Flower in Vassar Installation vs. Baseline

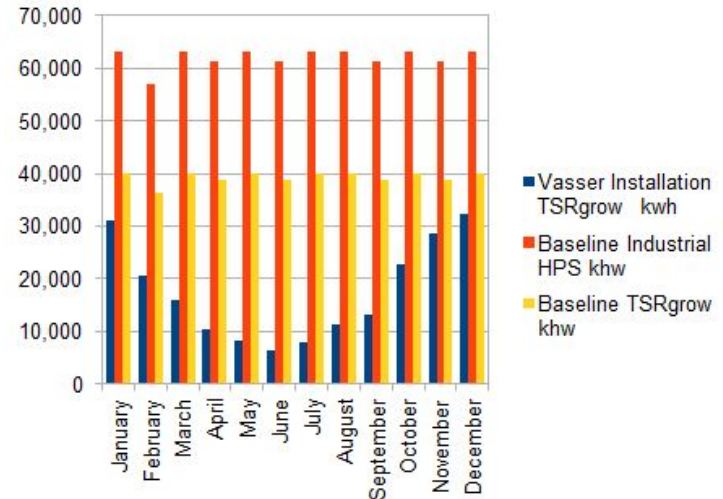

Tweaking Lighting Response Rates

Applying a data filter to light sensors reducing cycling of equipment

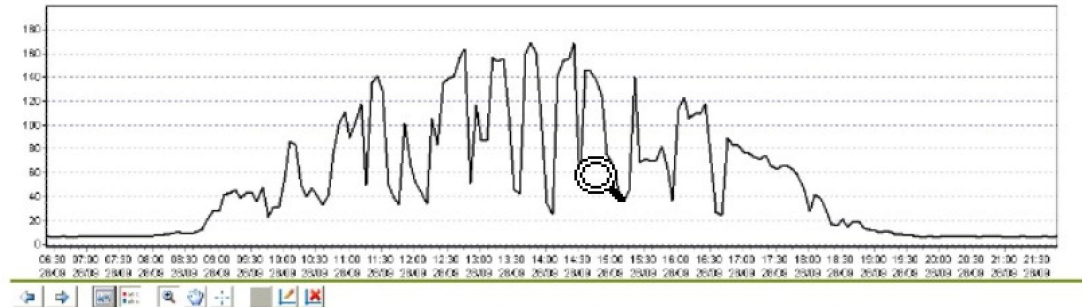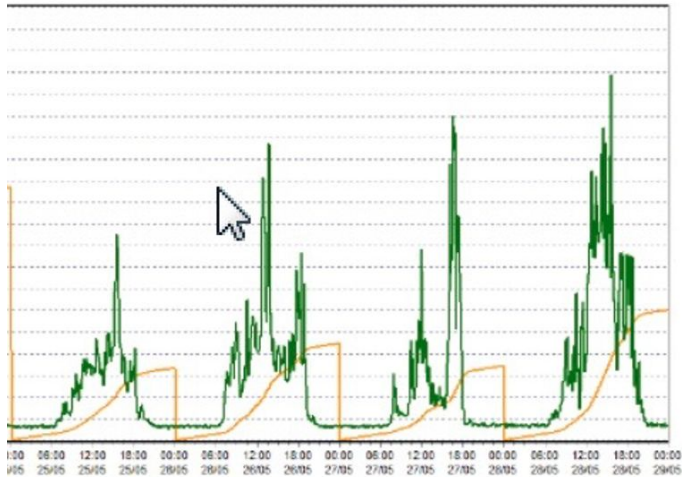


Lighting and Environmental Controls

Lighting Interactive Effects

- Ambient conditions can affect demand for lighting (schedule and intensity)
 - Greenhouses have dynamic temperature, humidity, CO₂

Systems Affected by Lighting

- HVAC and humidity management
- Fertigation
- Curtain controls

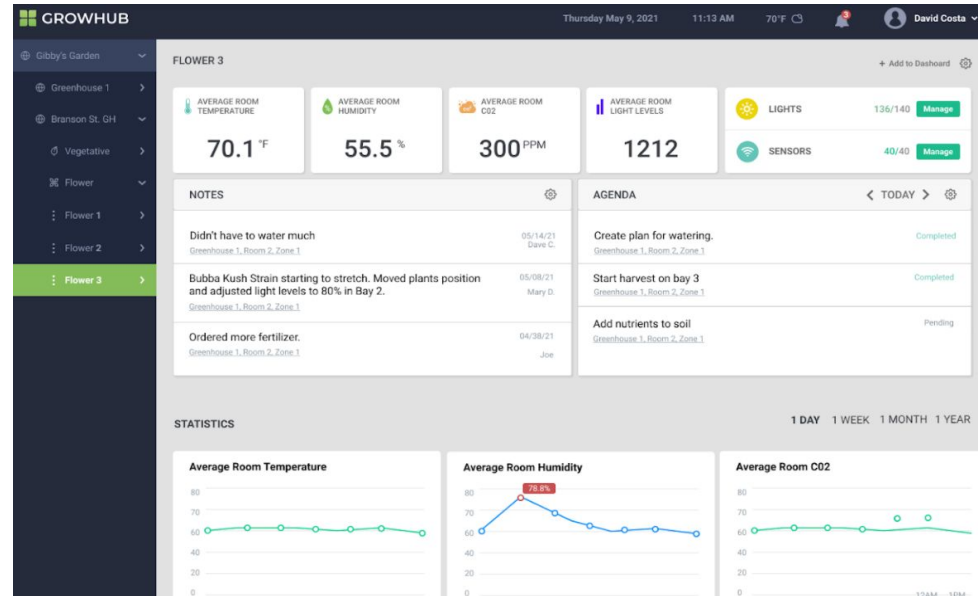

Dive Deeper into Lighting Controls

The Right Light

CANNABIS
BUSINESS TIMES

[READ MORE](#)

How Manipulating Light
Treatments Affects Plant
Expression

CANNABIS
BUSINESS TIMES

[READ MORE](#)

How LED Light Recipes
and Controls Can
Improve Quality and
Yield for Cannabis

Producers

cannabis
science and technology
advancing research, quality & education



[READ MORE](#)

Articles co-authored by RII with members of our Technical Advisory Council Working Groups



SECTION 07


**ENVIRONMENTAL CONTROLS
AVOIDING MICROCLIMATES**

Greenhouse Climate Control Approaches

Passive Climate Control

Ventilated greenhouses can use low-energy solutions like roof vents to release hot, humid air.

Passive solutions can manage climatic conditions in greenhouses, but actual environmental conditions can range widely.

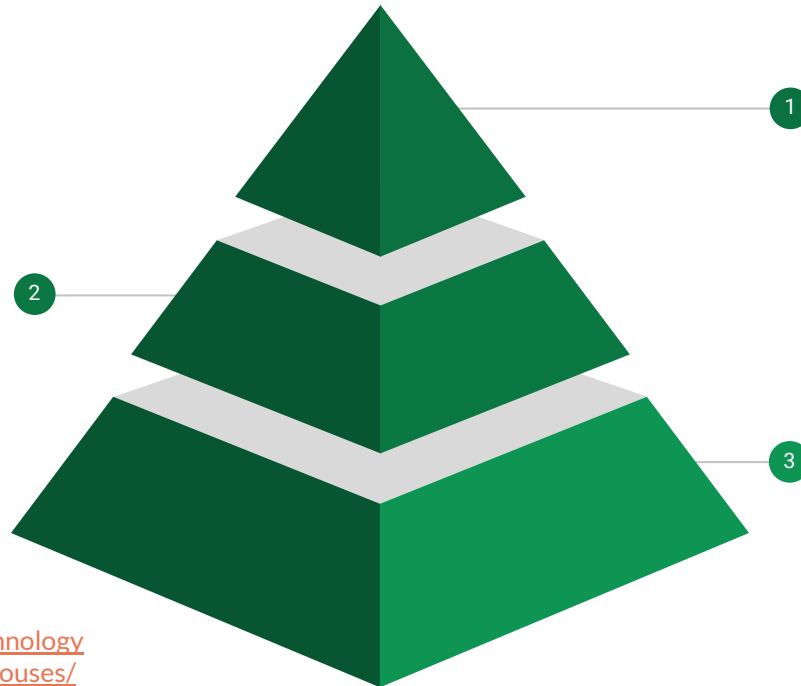

Active Climate Control

Ventilated greenhouses can be actively ventilated using ventilation fans to cool and dehumidify growing spaces.

Well-sealed greenhouses can achieve target environmental conditions by using fans, evaporative cooling walls, refrigerant-based cooling and dehumidification equipment, and mechanical heating systems.

Greenhouse Envelope

Ventilated greenhouses use plastic or glass coverings which are hard to completely seal.

Greenhouses with insulated and tightly sealed envelopes can more actively control climate and achieve target environmental conditions.

HVAC Controls: Value Proposition

Optimize environmental conditions for plants

- Proper temperature (space, relative & leaf), humidity, airflow, CO2 levels
- Optimal plant growth, control mold, mildew and other pests
- ROI plus visibility of data to create a more stable operation

Reduce operating costs while maximizing efficiency and productivity



HVACD for Controlled Environment Agriculture


Demystifying Key Terms

- Cultivation
- Energy & Power
- Environmental Conditions
- General HVAC
- Energy Efficiency
- Construction
- Cultivation Key Performance Indicators (KPIs)

Key Concepts

Understand HVAC options

Learn tips for optimizing design, installing equipment, and operating HVAC systems effectively

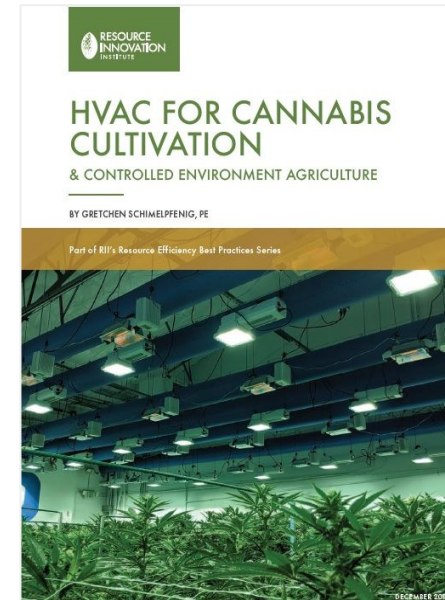

[DOWNLOAD NOW](#)

HVAC Controls: Recipes for Cannabis Steering

Table 7: Climate & Airflow Controls for Cannabis Steering by Stage of Plant Growth⁸

Climate Controls	Vegetative	Flowering	Ranges of Controls Values
Day-Night Temperature Difference	Smaller	Larger	0 - 9 degrees F
Afternoon Temperature Increase	None or small	Larger	0 - 5.5 degrees F
Start Time for Heating System	Earlier	Later	4 hours before sunrise to sunrise
Night-Day Temperature Increase	Higher	Lower	1 - 4.5 degrees F
Start Time for Day-Night Temperature Decrease	Earlier	Later	2 hours before to 2 hours after sunset
Speed of Day - Night Temperature Decrease	Slower	Faster	0 - 7 degrees F per hour
Average Daily Setpoint Temperature	Lower	Higher	68 - 82 degrees F
Vapor Pressure Deficit Target	Lower	Higher	0.8 - 1.5 kPa
Ventilation for Temperature Control	More	Less	Used for temperature control
CO ₂ Enrichment	More	Less	350 - 1500 ppm
Energy Screen	Close	Open	Used to manage plant stress

Greenhouse HVAC Controls

VPD Controls

- Target ranges vary by stage of plant growth
- Dial in energy-efficient VPD setpoint ranges

Airflow Controls

- Sizing for cultivation can range from 10 to 20 ACH, with some cases as high as 30 - 40 ACH
- Reduce supply air volume setpoint during dark periods

Understand energy savings potential of strategies and data needed to validate performance

Table 5: Climate and Airflow Controls Parameters Measured by Cannabis Cultivators

Climate and Airflow Data Collected ⁷	Percentage of Growers Collecting, 2020
Space Temperature	85%
Relative humidity	72%
CO2 concentration	66%
Leaf temperature	31%
Air speed	19%

Table 6: VPD Targets for Cannabis Cultivation

Cannabis Growth Stage	Target VPD Range (kPa)
Flower/Bloom/Mother	1.0 - 1.5
Vegetative	0.8 - 1.1
Clone/Seedling	0 - 0.2

Figure data source: Cannabis Business Times

Traditional Greenhouse HVAC Systems



Figure credit: Gretchen Schimelpfenig, University of Vermont

High-Performance Greenhouse HVAC Systems

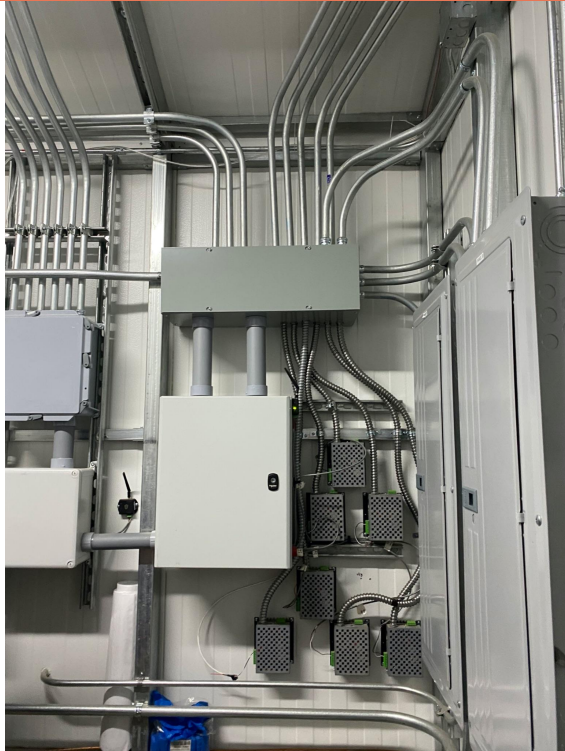


Figure credit: Ceres Greenhouse Solutions

High-Performance HVAC System Data

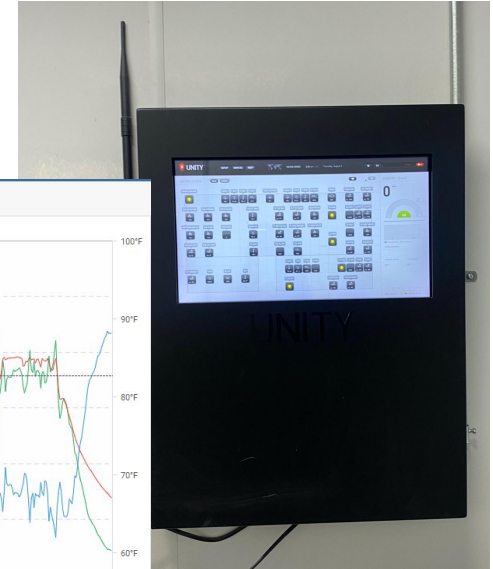
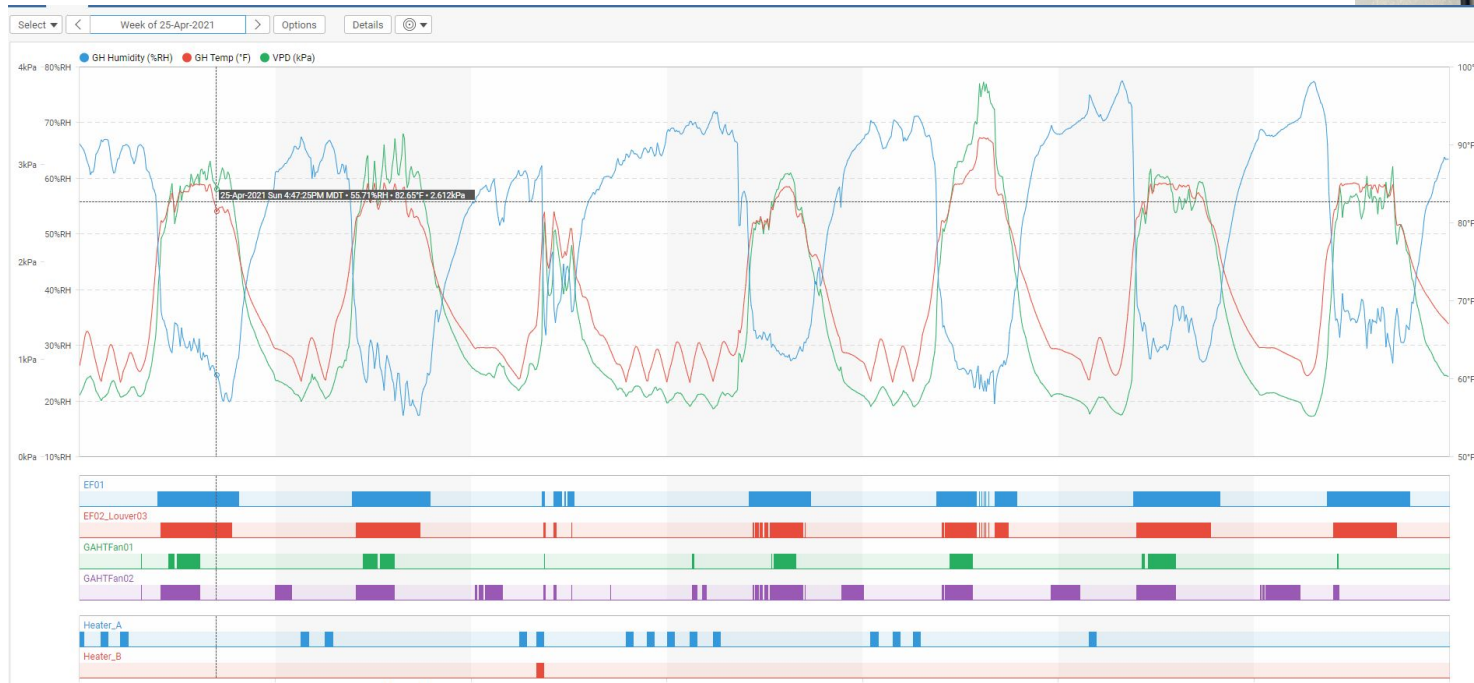


Figure credit: Ceres Greenhouse Solutions

High-Performance HVAC System Data

All Sites < May-2021 >

All Sites


Equip	Cooling Elec Cost	Cooling Energy Use	Cooling Equipment Runtime	Heater BTU	Heater Elec Cost	Heater Energy Use	Heater Propane Cost	Heater Propane Use	Heater Runtime
Something From The Farm Circ Fans	\$25.11	279kWh	7.49day						
Something From The Farm EF01_24in	\$8.48	94.26kWh	9.56day						
Something From The Farm EF02_24in_LouverC	\$6.35	70.61kWh	6.23day						
Something From The Farm EF03_36in	\$0.50	5.606kWh	9.46hr						
Something From The Farm EF04_36in	\$2.39	26.56kWh	1.87day						
Something From The Farm GAHT Fan A	\$11.18	124kWh	4.36day						
Something From The Farm GAHT Fan B	\$18.10	201kWh	6.81day						
Something From The Farm Heater A				384,071h_BTU	\$0.31	3.486kWh	\$13.12	5.247gal	6hr
Something From The Farm Heater B									
Something From The Farm LouverA&B			11.23day						
Something From The Farm Wet Wall Door	\$1.90	21.14kWh	4.99day						
Something From The Farm Wet Wall Pump	\$2.66	29.5kWh	12.97hr						

Figure credit: Ceres Greenhouse Solutions

Mechanical Cooling Equipment

Cooling


- Cooling equipment to maintain target environmental setpoints
 - Evaporative systems:
 - Pads and fans (P&F)
 - High-pressure fog (HPF)
 - Refrigerant-based cooling systems
 - Direct expansion (DX)
 - Heat pump equipment
- Often automatically controlled
 - Can be staged on after passive ventilation strategies

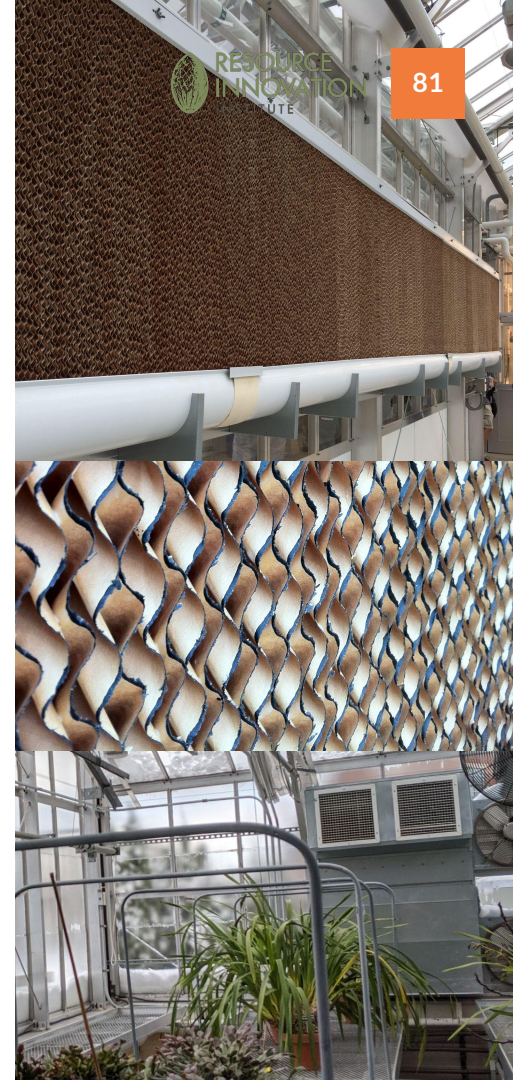

Mechanical Heating Equipment

Heating

- Radiant systems to maintain target environmental setpoints
 - Associated pumps
- Unit heaters
- Heat pump equipment
- Sizing heating equipment for CEA
 - Winter / night conditions
 - Depend on cultivar
 - Affected by supplemental lighting
 - Determine design conditions for winter / night
- Temperature controls for hydronic and ducted systems

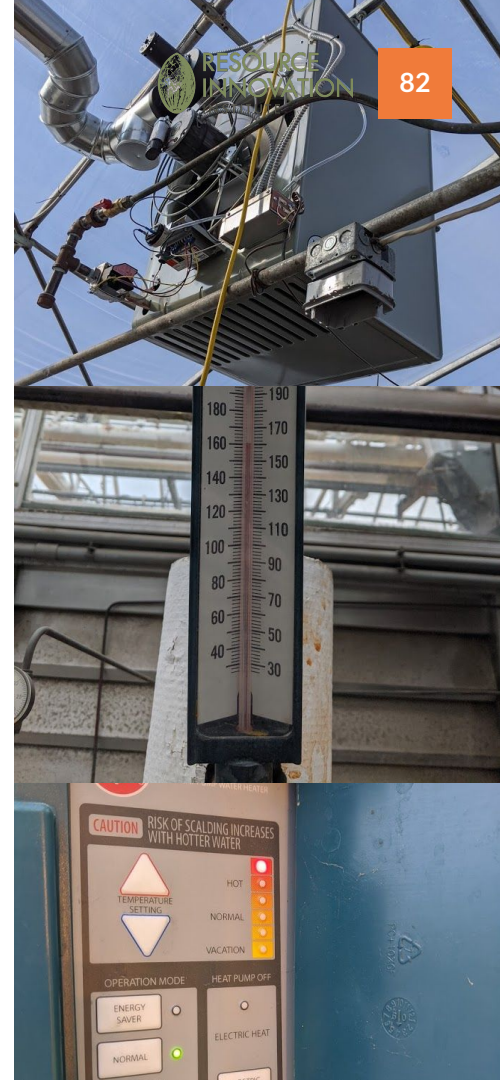

Climate & Airflow Controls

Climate & Airflow

- Mapping your facility
- Use the environment to your advantage
 - Consider advanced in-ground designs for heat capture/re-use/recirculation and cooling

Monitor and Measure to Control

- Sensors throughout facility
 - At all levels and in the ground
- Feed-forward predictive control
 - Reacts to environmental influences before they are reported by sensors




HVAC Controls: Interactive Effects

Respond to light and water

- Orchestrate your envelope HVAC controls to call and respond to daily and seasonal solar variation and your supplemental lighting controls
- When the sun sets, humidity spikes, and control strategies give envelope and HVAC equipment more time to ramp up and respond
- Likewise, plant stage of growth and timing of watering events can demand more of your HVAC system


HVAC equipment should monitor both lighting and irrigation controls activities for faster response times and happier plants

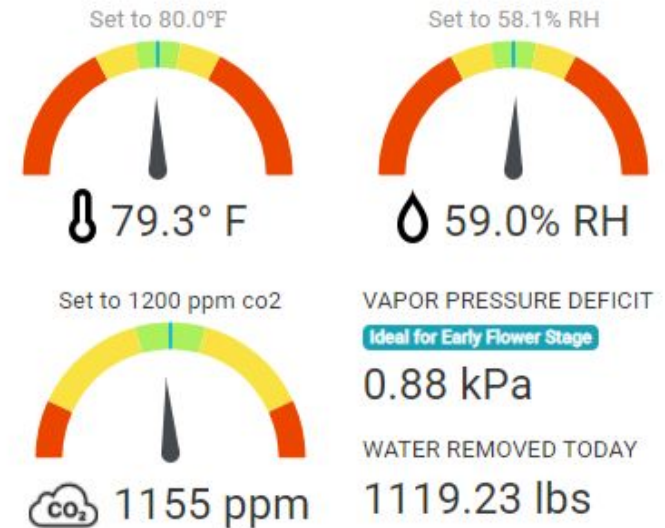

Integrated Greenhouse Controls

Intelligent Cooling with Feed-Forward Controls

- Feedback alone can cause poor control and wasted energy
- Using feed-forward integrated controls, HVAC controls can preemptively anticipate weather conditions to improve control and save energy.
- Hardware communicates with software to inform systems of actual conditions in the greenhouse
- Environmental controls orchestrate which system should respond:
 - Vents, curtains, fans, active cooling

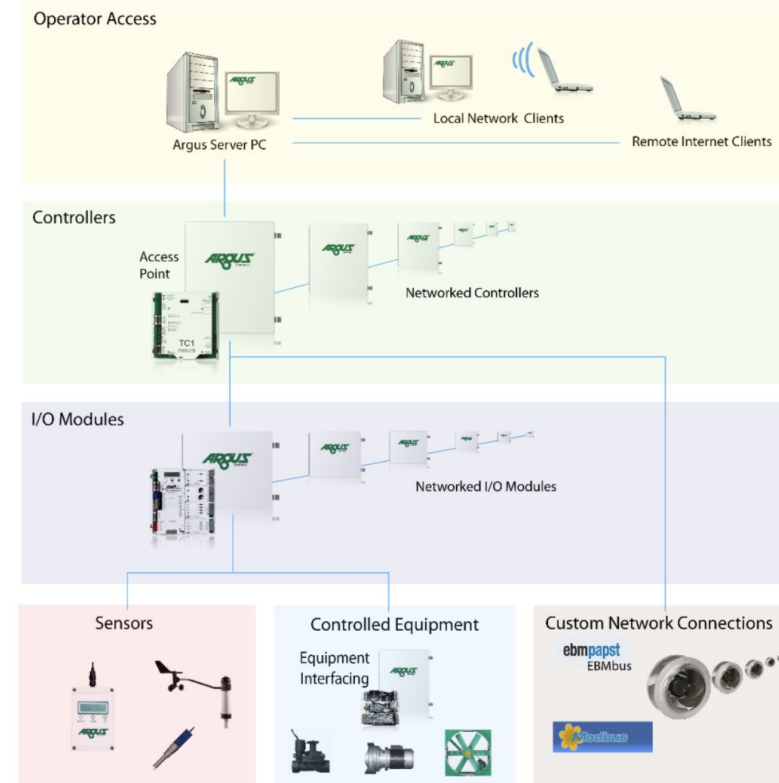


HVAC Controls: VPD Controls

Maintain efficient VPD targets

- There is not a target VPD that is appropriate for all cultivars, environments, or cultivation methods
- Consider acceptable VPD ranges by stage of plant growth

Dial in HVAC system automation to tailor VPD to specific cultivars, systems, and facility configurations

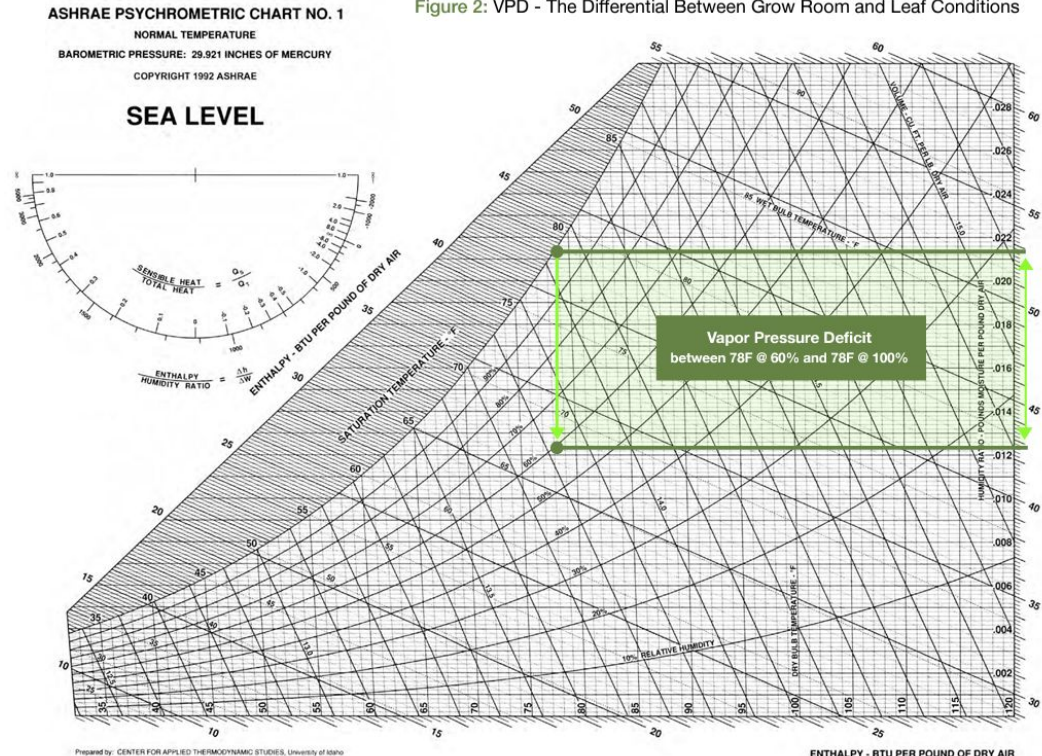

Maintaining Airflow


Ventilation & Circulation Fans

- Using both leeward and windward vents can allow for smaller openings
 - Leeward to reduce temperatures and remove excess humidity
 - Windward vents can create greater air movement above thermal curtains
- Size ventilation fans properly for your airflow requirements:
 - For hot season growing use 8 CFM per square foot of growing space
 - For cooler season growing use 2 CFM per square foot
- Install circulation fans to satisfy flow rates of 25% of your greenhouse's volume per minute



Plant Empowerment Concepts for Cannabis

1. Control radiation with thermal curtains
 - a. Close energy screens to limit heat emission from plants at night
 - b. Open energy screens later in AM and close earlier in PM
2. Determine what equipment serves what purpose
 - a. Circulate and ventilate to actively maintain airflow
 - b. Improve humidity control with HVACD equipment
3. Document target environmental conditions
 - a. Select targets to maintain plant balances
4. Operate HVAC equipment to maintain a uniform climate
 - a. Stage equipment to achieve target environmental conditions
5. Monitor VPD, lighting system operation, and energy flows
6. Base irrigation on total energy flows and VPD monitoring

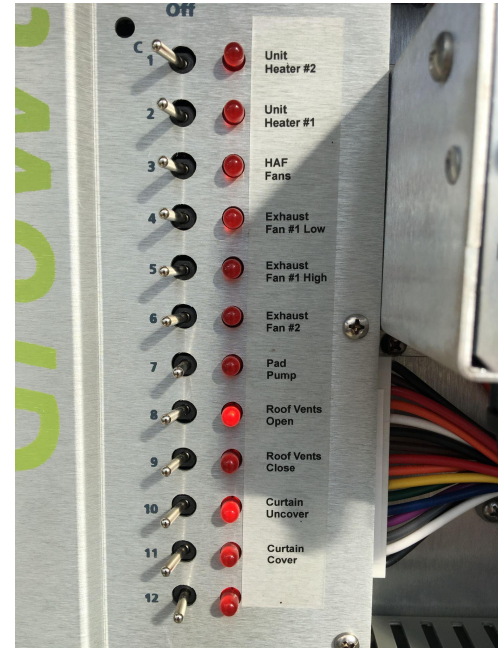

Commissioning Environmental Controls

Monitoring

- You can't manage what you don't measure...but you can't measure what you don't monitor
- Make data to support savings claims

Calibration

- Ensure sensor accuracy so HVAC systems respond to actual environmental conditions
- Configure response times to reduce short-cycling

Commissioning

- Functionally test HVAC sequences of operation to ensure persistent energy savings



Figure credit: Gro iQ / InfiSense

Dive Deeper into Environmental Controls

Empowering Plants with
Environmental Controls
Systems

**GREENHOUSE
GROWER** 

[READ MORE](#)

Avoiding Cannabis Crop
Loss in Cultivation

**GREENHOUSE
GROWER** 

[READ MORE](#)

Integrated Pest
Management for
Cannabis Cultivation
Monitoring, Identifying,
Preventing, and
Controlling Pests with
HVAC Solutions

cannabis 
science and technology
advancing research, quality & education

[READ MORE](#)

Articles co-authored by RII with members of our Technical Advisory Council Working Groups



SECTION 06

EFFICIENCY PROGRAM EXAMPLES


Efficiency Utilities Serving Tri-County

Three Regional Utilities with Efficiency Programs

- Utility service territories determine eligibility
- Growers in Tri-County region can benefit from technical assistance and financial incentives
- Incentives reduce the first cost of high-performance technology



Cannabis Efficiency Project Landscape

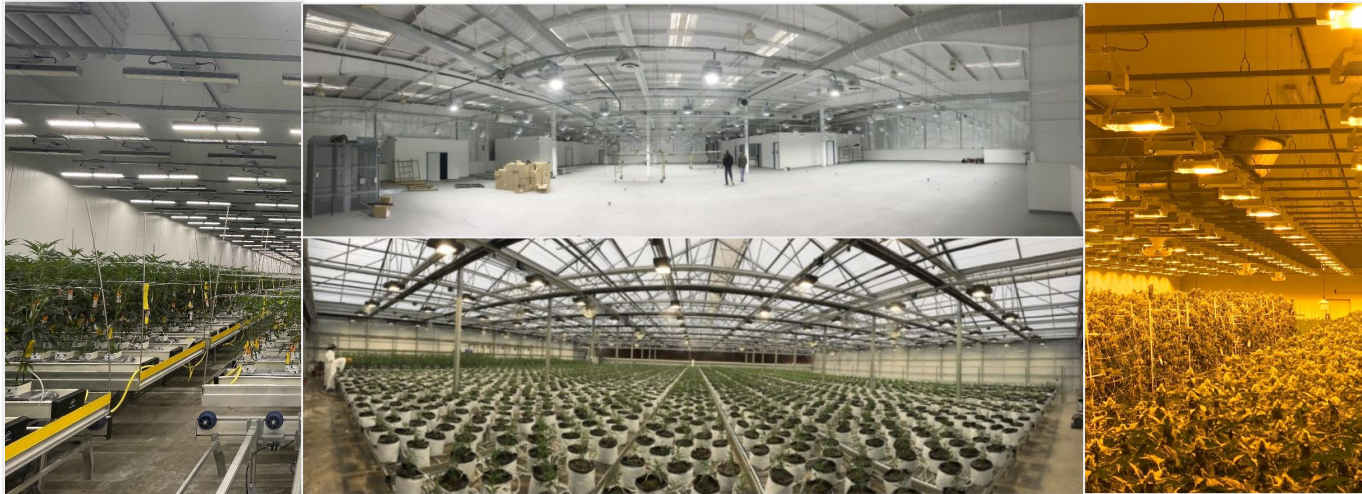

Read customer testimonials at

<https://www.socalgas.com/for-your-business/energy-savings/rebate-and-incentive-testimonials>

SoCalGas Programs for Producers

Energy Efficiency Programs



- **Agriculture Energy Efficiency Program (AgEE)**
 - New program implemented by ICF, EnSave, and ERI Pacific
 - Financial incentives of up to 50% of the project cost
 - Projects must be installed by the end of 2023
 - Incentives for some projects are available back to June 7th, 2021
 - SoCalGas customers can contact Karl from EnSave at karlj@ensave.com
 - Send general program emails to AgEE@CAEnergyPrograms.com
 - Call 844-523-9981

Visit <https://caenergyprograms.com/AgEE>

SoCalGas Greenhouse Customer Incentive Examples

Project 1:

Sunnyland Nurseries - Greenhouse

Energy management system

- Saves energy by monitoring climatic changes and automatically adjusting setpoints inside greenhouse
- “Does a better job than I did,” notes owner Robert Akashi

Energy Saving Results

4,800 therms per year
Incentives \$3,850

Project 2:

Skyline Flowers - Greenhouse

Infrared film

- Saves energy by reducing thermal cooling at night
- “If you’re aware of the program and know what it offers, the rebates can be substantial for agriculture businesses”

Energy Saving Results

20,000 therms per year
Incentive \$25,000

SoCalGas AgEE Program Offerings for CEA Customers



Energy Efficient Equipment Incentives

- Heat curtains / energy screens: \$0.35 - \$0.50 per sq. ft.
- Infrared (IR) film: \$0.045 - \$0.10 per sq. ft.
- Condensing boilers: \$6.00 - \$10.00 per rated kBtu capacity
- Pipe insulation: \$2.50 - \$4.00 per linear foot
- Custom projects: \$2.50 - \$3.00 per first-year therm saved

Other Program Offerings

- Free technical assistance to identify and prioritize greenhouse energy efficiency projects
- Energy audits and facility walkthroughs for large customers
- Direct installation of select measures at low/no cost for growers in disadvantaged communities
- Zero-percent on-bill financing up to \$100,000 per meter

All SoCalGas customers qualify for participation. Contact EnSave for more information!

A large indoor cannabis cultivation facility. The image shows a long, narrow aisle between rows of cannabis plants. The plants are green and have serrated leaves, typical of cannabis. They are growing in a controlled environment with a complex metal and glass structure overhead. The structure includes a network of pipes, wires, and fans, suggesting a sophisticated climate control system. The lighting is bright and even, highlighting the plants and the structural details. The overall atmosphere is industrial and focused on agricultural production.

Q & A

CONTACT US



RESOURCE
INNOVATION
INSTITUTE

Visit us at

www.ResourceInnovation.org

P.O. Box 5981

Portland, Oregon 97228

derek@resourceinnovation.org

gretchen@resourceinnovation.org

carmen@resourceinnovation.org

